




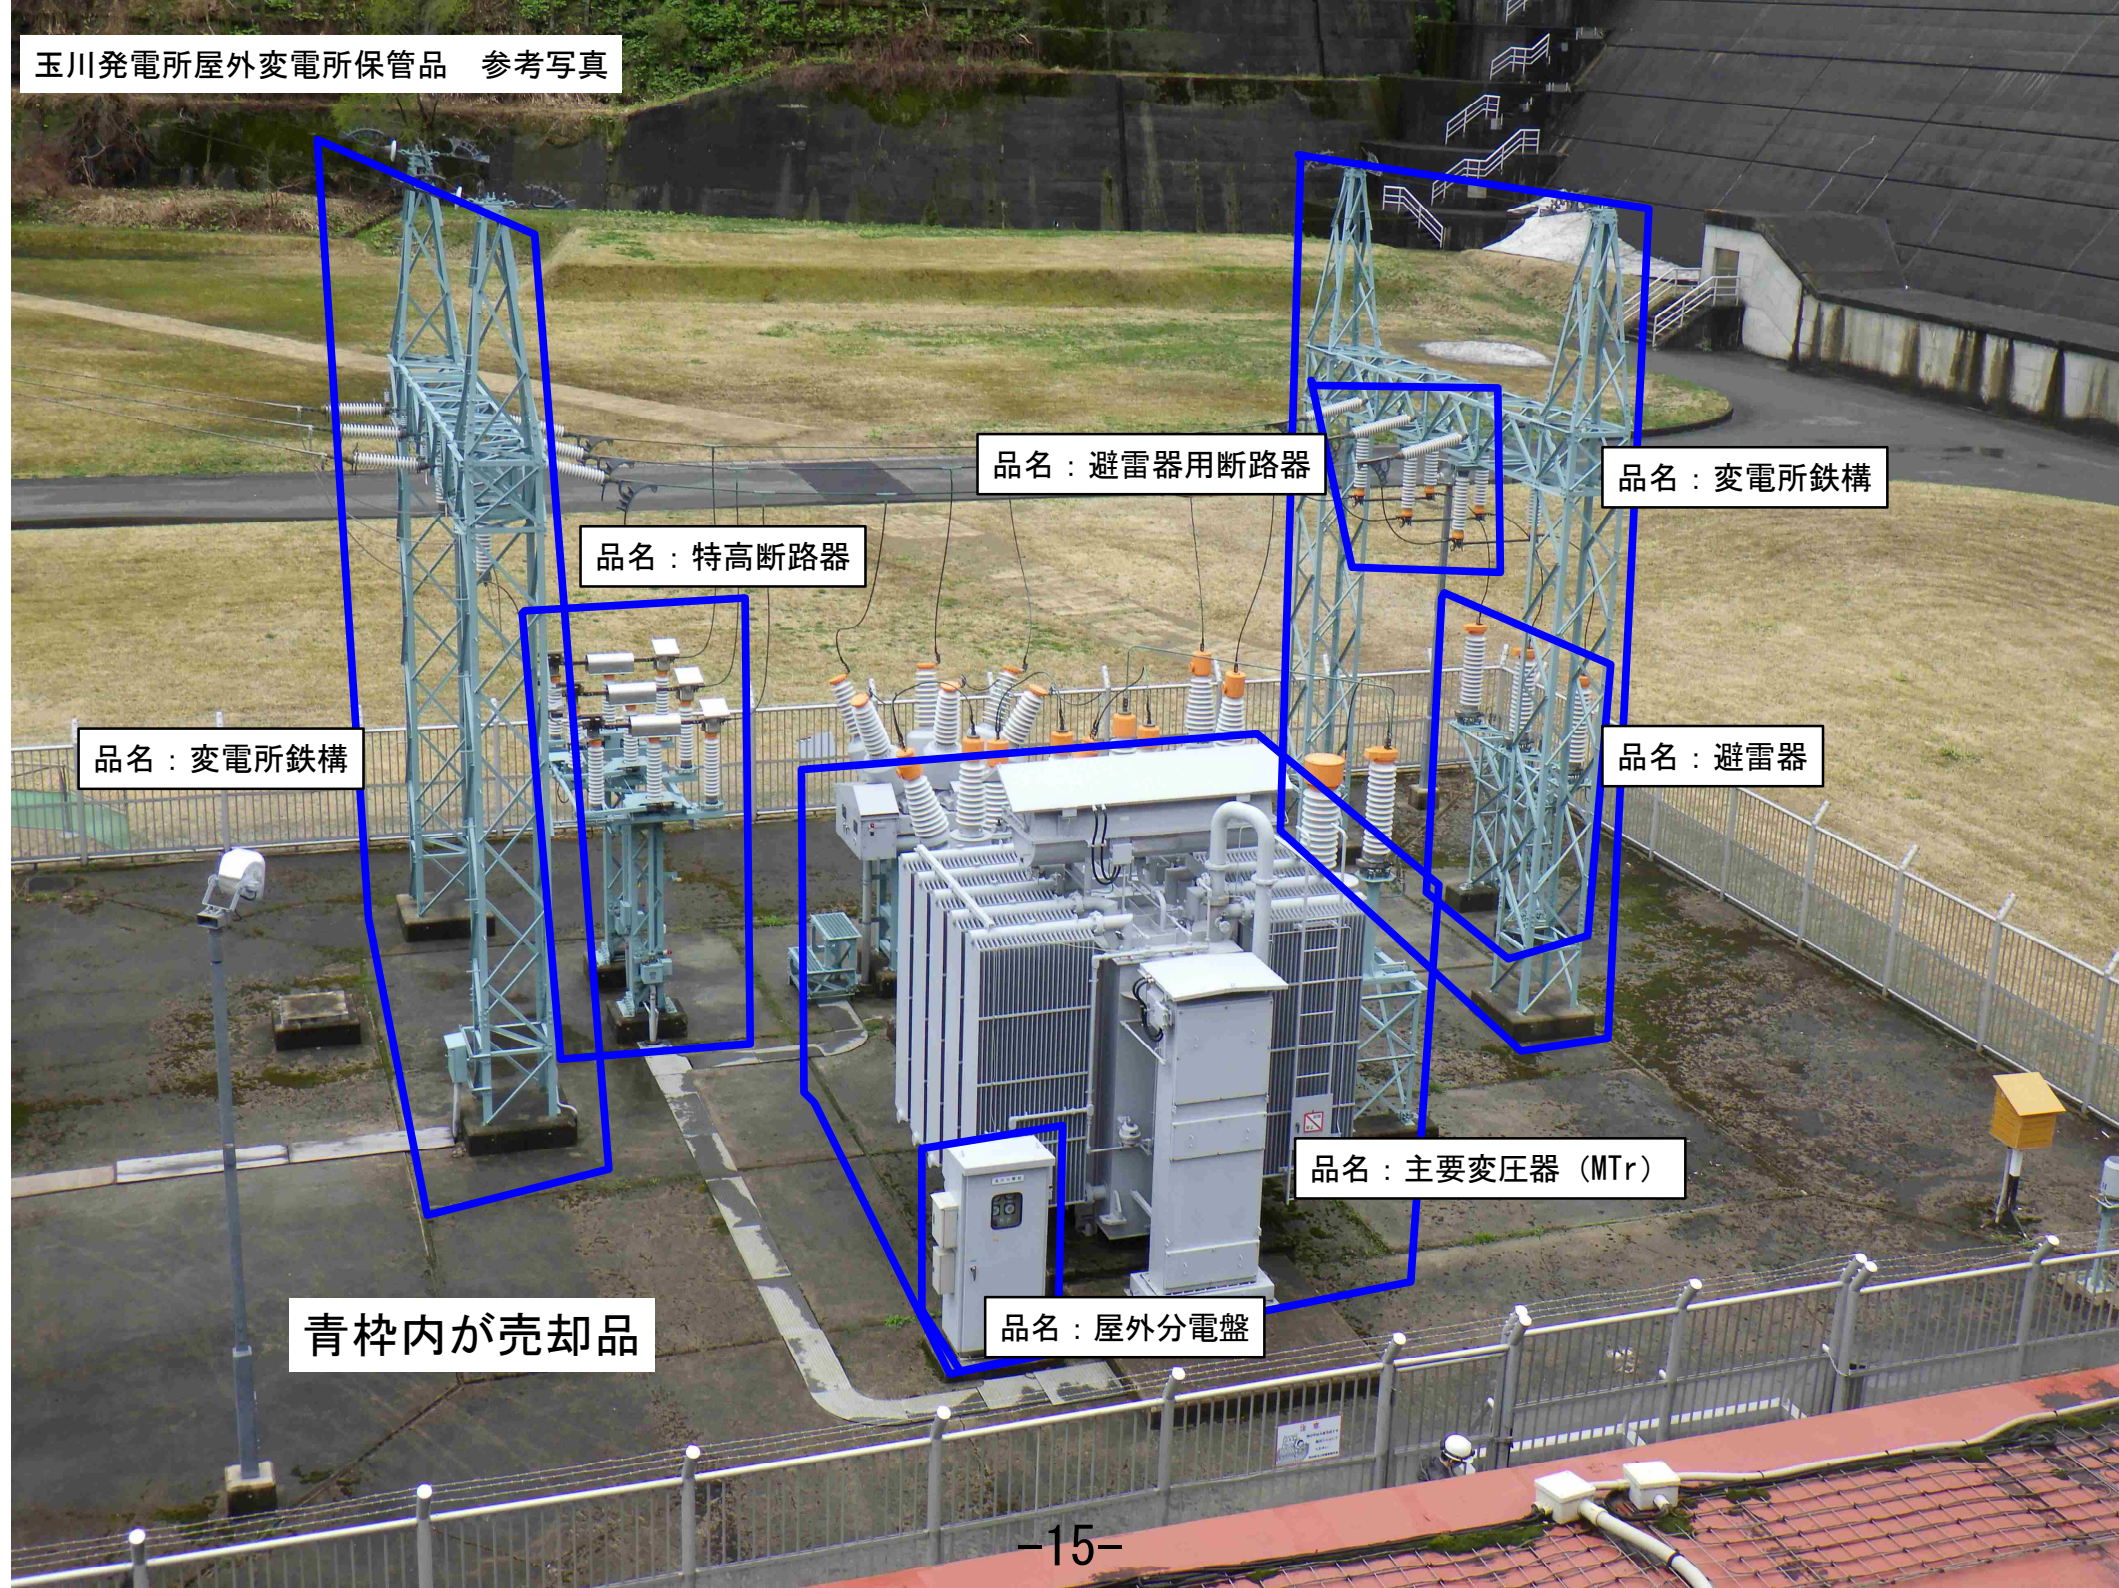

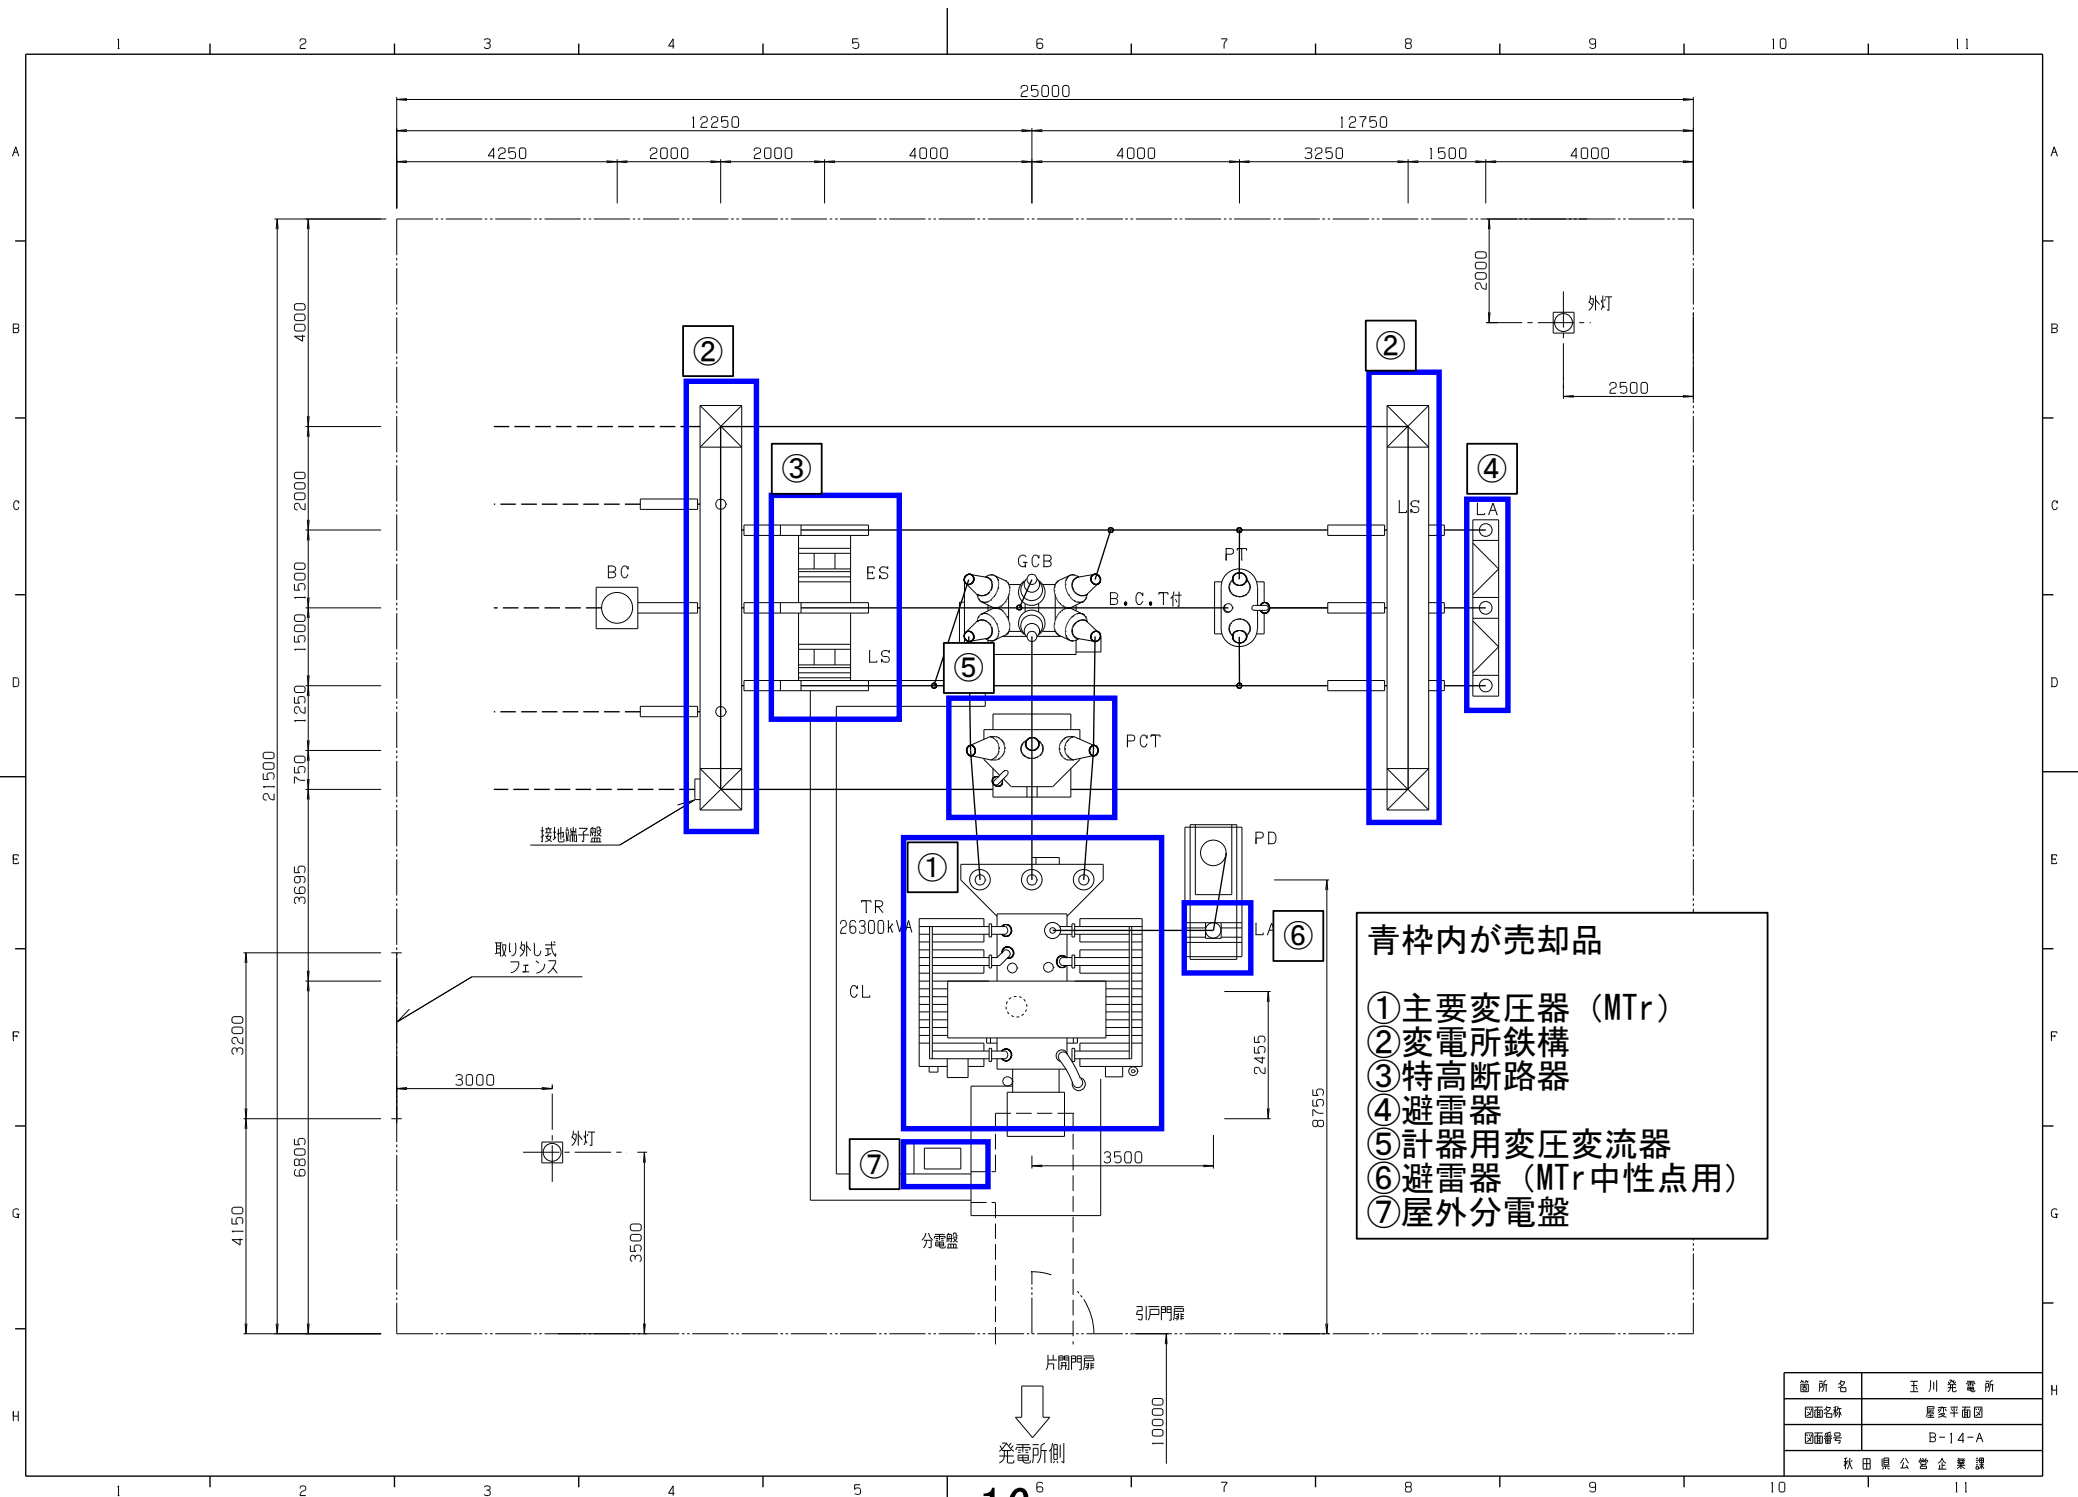





箇所名	玉川発電所
図面名称	屋変平面図
図面番号	B-1.4-A
秋田県公営企業課	

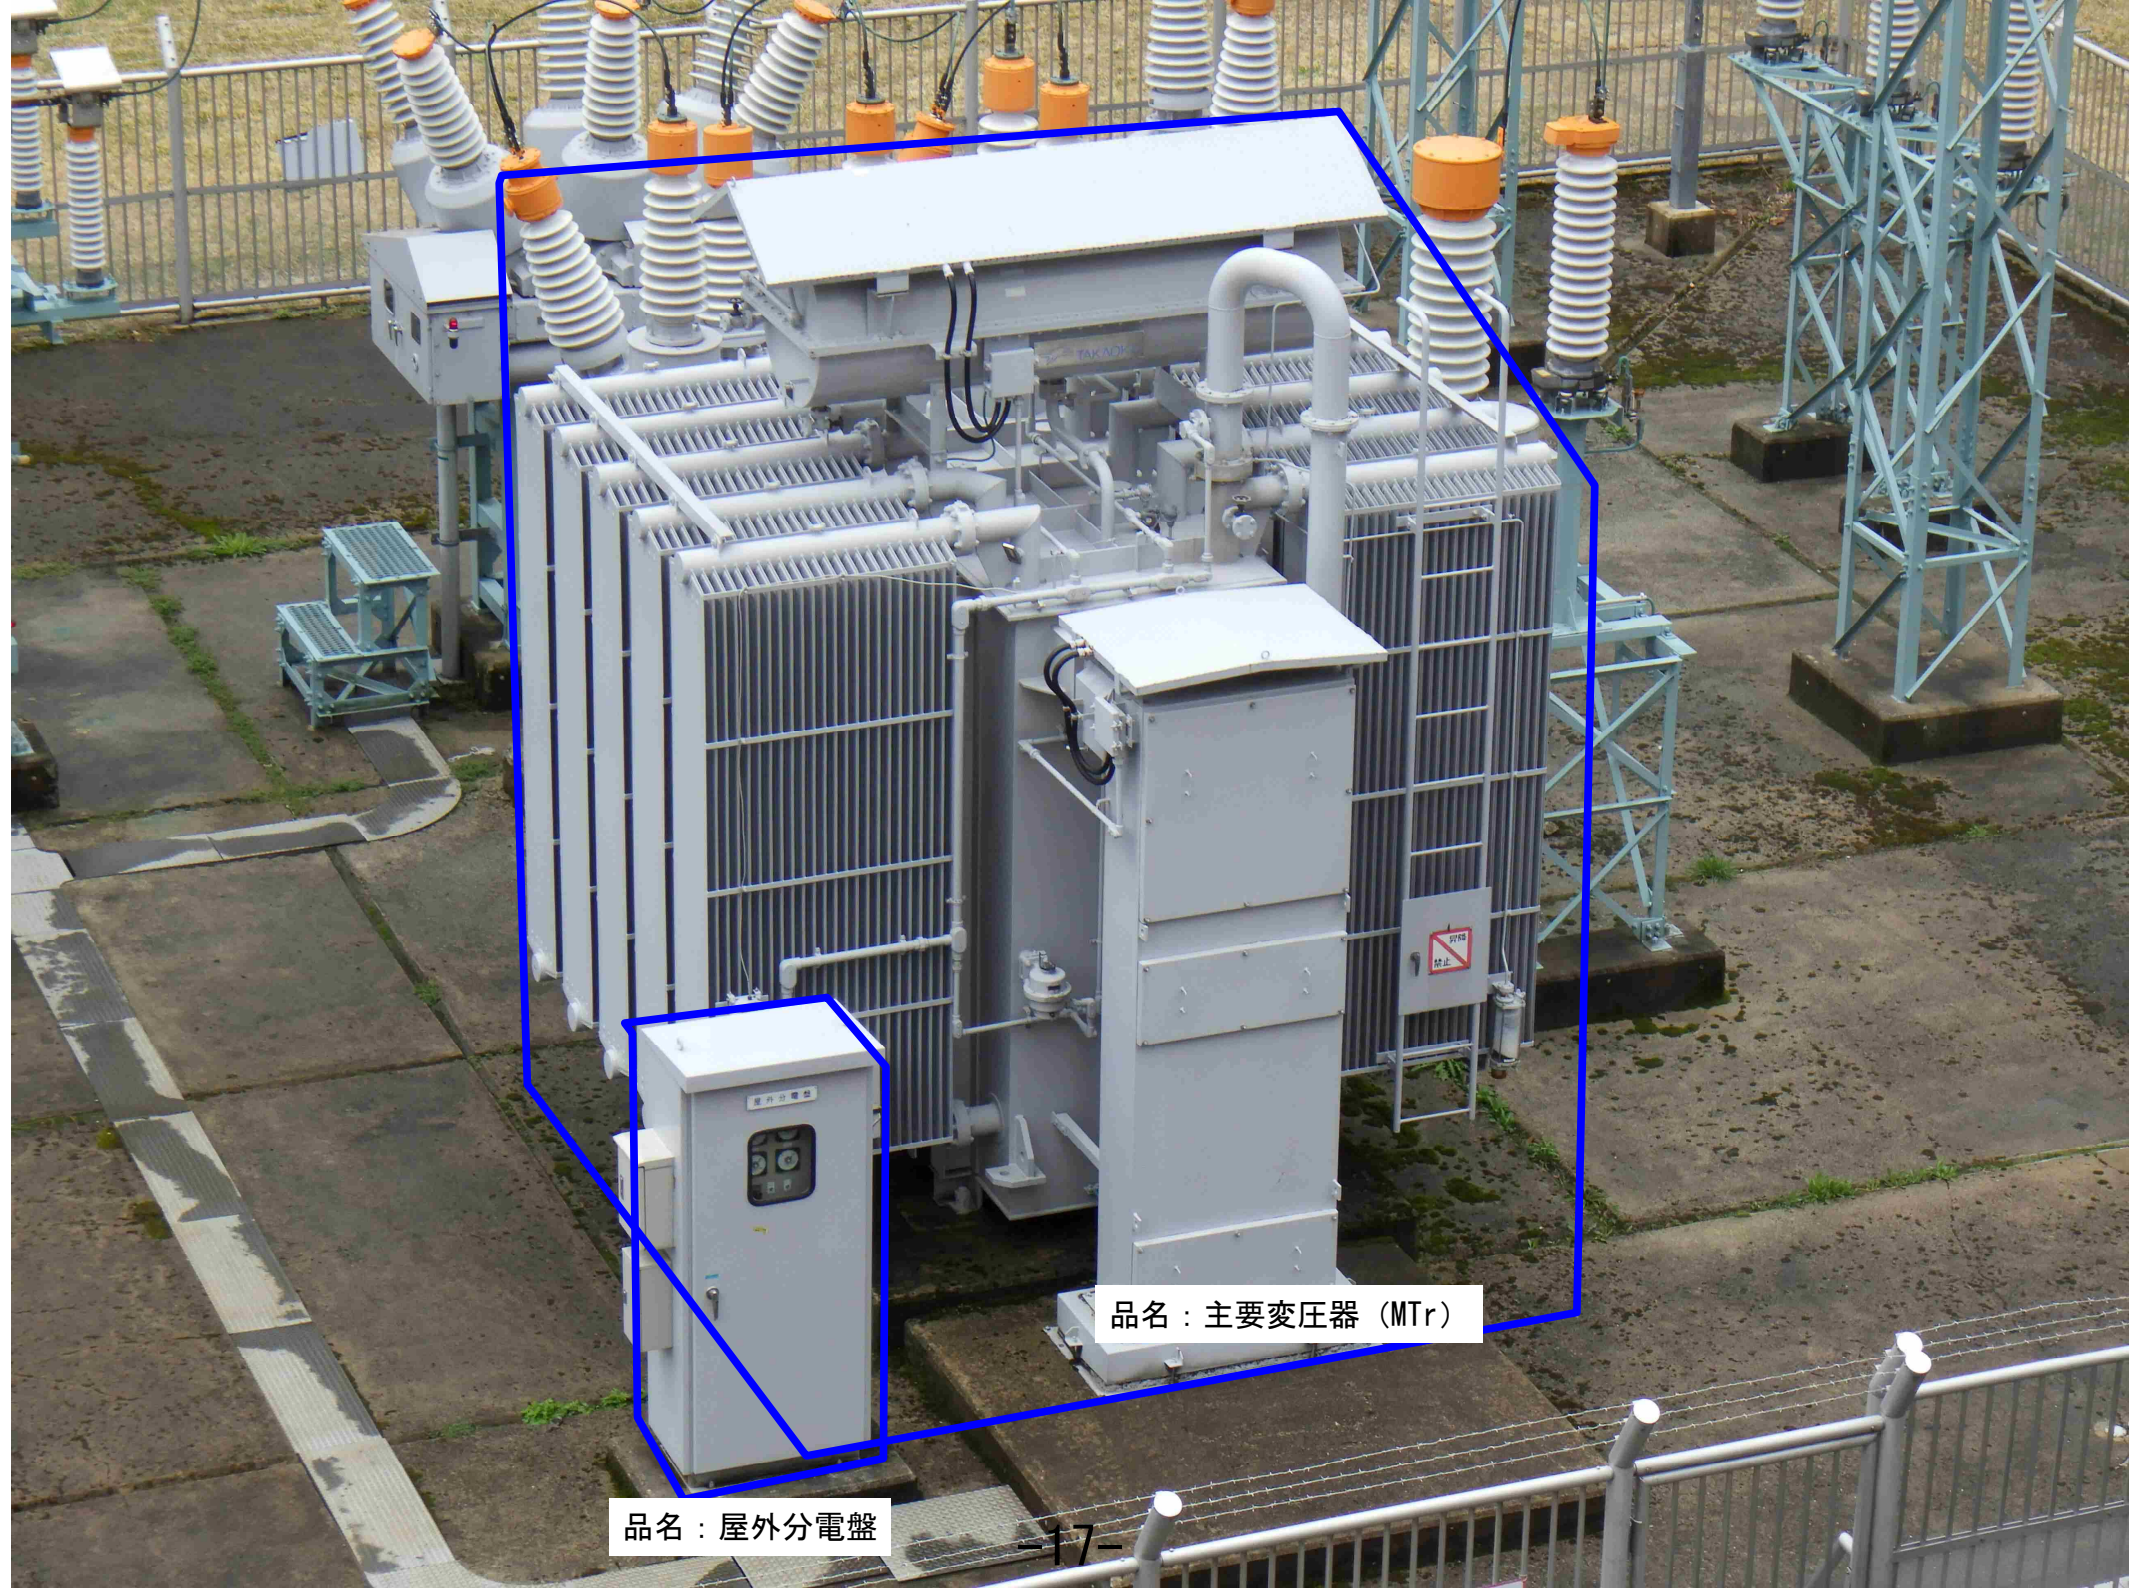

品名：主要変圧器（MTr）



品名：屋外分電盤

主要変圧器 (MTr) 参考図面

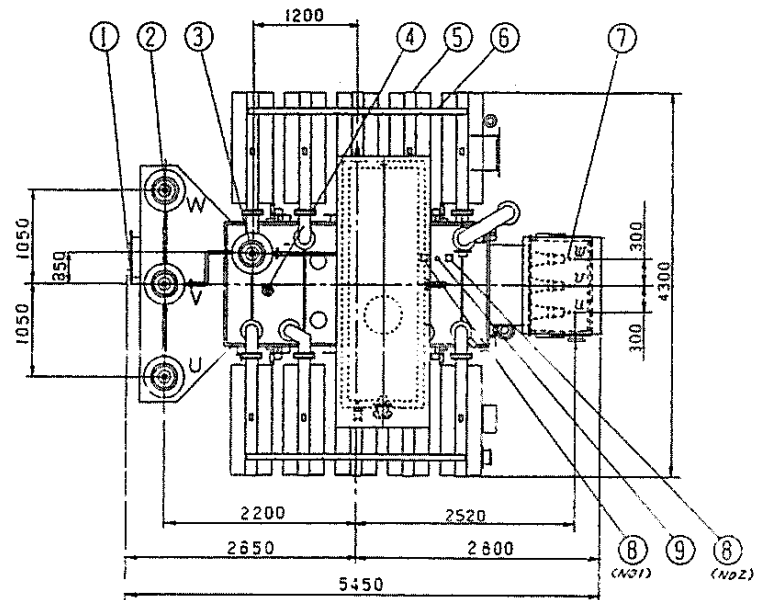

定格容量	26300 kVA
相数-周波数	3 相 50 Hz
一次電圧	10.5 kV
二次電圧	F69/R66/F63 kV
冷却方式	ONAN
結線	Δ-Y
形式	STROD, CL-2
使用場所 油汚化防止方式	屋外用 無圧密封式
総重量	46400 kg
総油量	11600 ℓ
中身吊上重量	23500 kg
中身吊上寸法	7100 mm
塗装色 (マンセル記号)	N7 (耐酸塗装)
輸送重量	35000 kg

・上記重量は設計値ですから、組立運搬用具その他の設計には10%程度の余裕を見込んで下さい。

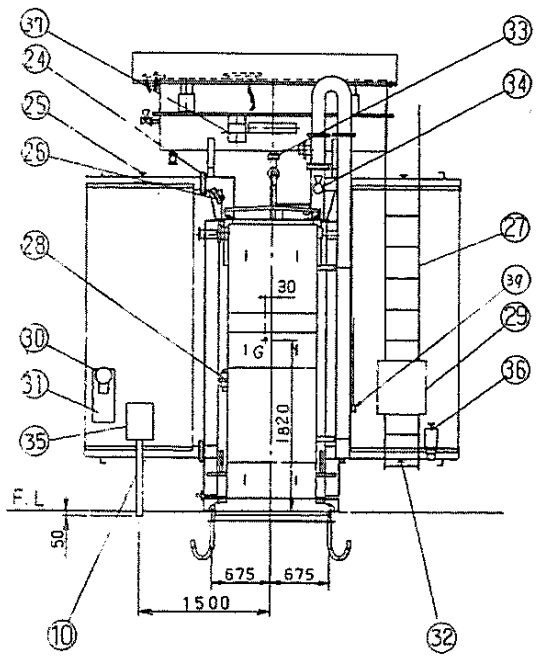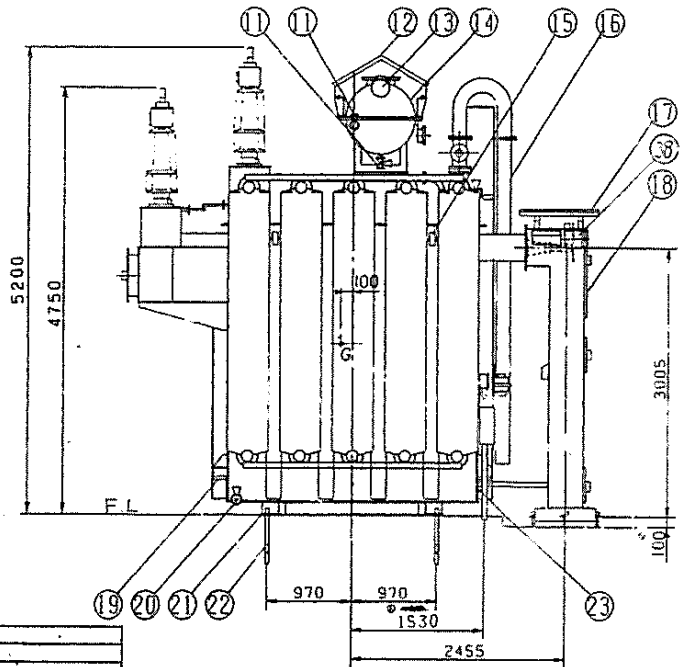


20 油ろ過器接続	32A	40	
19 ジョッキボス		39 放熱板固定用ボルト	
18 ダクト		38 ナマコ端子箱	ダクトに接続する
17 放熱用パネルヒーターダクト用		37 ナマコ端子箱	コンパネに接続する
16 放熱管		36 吸排呼吸器	
15 フリ耳		35 端子箱	
14 コンクベータ		34 油ろ過弁	32A
13 ダイアル油面計		33 油止ノリ	
12 放熱用パネルヒーターコンパネ用		32 放熱器油接続	
11 油ろ過弁	25A	31 芯板	
10 保護パイプ	φ75.2	30 温度検出器	2 検点付
9 温度検出器口出し部		29 危険防止とびら	
8 温度検出器	0°C 100Ω 2ヶ	28 油圧検出器	
7 一次ブッシング	11-M 2000A	27 はしご	
6 放熱器振れ止め		26 検点検出器	
5 放熱器		25 放熱器空気接続	
4 放電圧タ・ブッシング		24 放熱器外	
3 二次中性点ブッシング		23 接地端子	22~150mm用
2 二次ブッシング	77-L 600A	22 接地ボルト	
1 マンホール	77-L 600A	21 ベース	

APPROVED BY: 手 野 11-11-20
 CHECKED BY: S. E. 11-11-20
 DRAWN BY: 手 野 11-11-20
 NOTE:

変圧器外形図

A horizontal number line with tick marks labeled B, C, D, E, F, and G. The line is divided into five equal segments by these points.

A vertical scale with five horizontal tick marks. The numbers 1, 2, 3, 4, and 5 are placed to the left of the tick marks, corresponding to the top, second, third, fourth, and bottom marks respectively.

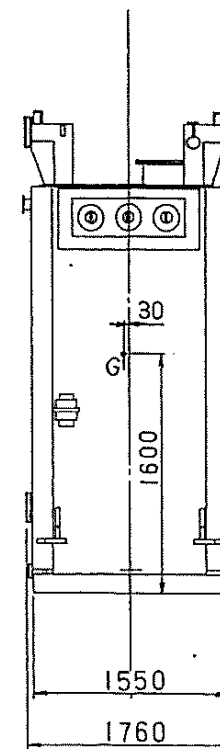


APPROVED BY:	平野	11-11-88
CHECKED BY:	S = K	11-11-88
DRAWN BY:	増山	9-11-88
NOTE	増山 6-12-88 変更通知	

輸送区

DT 303716

主要変圧器 (MTr) 参考図面

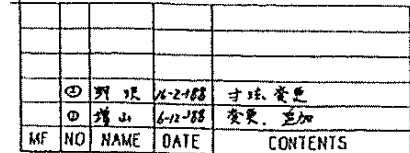





品名：避雷器（MTr中性点用）
変電所機器架台

